



SK-5235 Remote Annunciator



Program and Operate the SK-5208 FACP from a Distance with the SK-5235 Remote Annunciator.

The SK-5235 remote annunciator provides remote annunciation for the 5208 Fire Alarm Control Panel. The SK-5235 performs all system operations. It also provides trouble and alarm information and can be used for programming. The SK-5208 can support up to six 5235 Remote Annunciators.

Operation

When the system is normal and receiving AC power, the power LED is on and all other LEDs are off. Other LEDs turn on as the conditions occur.

Users identify themselves to the control panel by entering a code on the annunciator. When a user presses a button, the annunciator piezo beeps and the LCD prompts the user to enter a code or other relevant information.

Multiple users can work at different annunciators simultaneously without affecting each other.

Features

- 2-line 16-character LCD display
- Indicates Trouble, Alarm, Supervisory, and System Status conditions with LEDs and LCD display
- Each SK-5235 is individually supervised by the SK-5208 FACP.
- Up to 6 per SK-5208 FACP
- Operation and appearance comparable to the control panel's on-board annunciator
- Can be wired up to 1500 ft from FACP



SK-5235 Remote Annunciator

Specifications

| | |
|--------------------|-----------------------|
| Operating Voltage: | 24 VDC |
| Current Draw: | |
| Standby: | 30 mA |
| Alarm: | 50 mA |
| Dimensions: | |
| Width: | 7-3/16" (18.26 cm) |
| Height: | 5" (12.7 cm) |
| Depth: | 1-1/8" (2.86 cm) |

| | |
|--------------------------|--------------------------------|
| Operating Temp: | 32° to 120° F (0° to 49° C) |
| Maximum Wiring Distance: | 1500 ft. |



**SILENT
KNIGHT**


SK-5235

Remote Annunciator



Engineering Specifications

The contractor shall furnish and install where indicated on the plans, the Model SK-5235 Remote Annunciator. Module shall be of a LCD type with a 2X16 display. Module shall be capable of remote programming as well as providing alarm, trouble information along with resetting of alarms and silencing of trouble and alarm conditions. Module ID shall be programmed with a 4 position DIP. The control shall be capable of supporting up to 6 supervised SK-5235. Module shall be designed to mount on a dual gang electrical box with 18 gauge to 14 gauge wire.

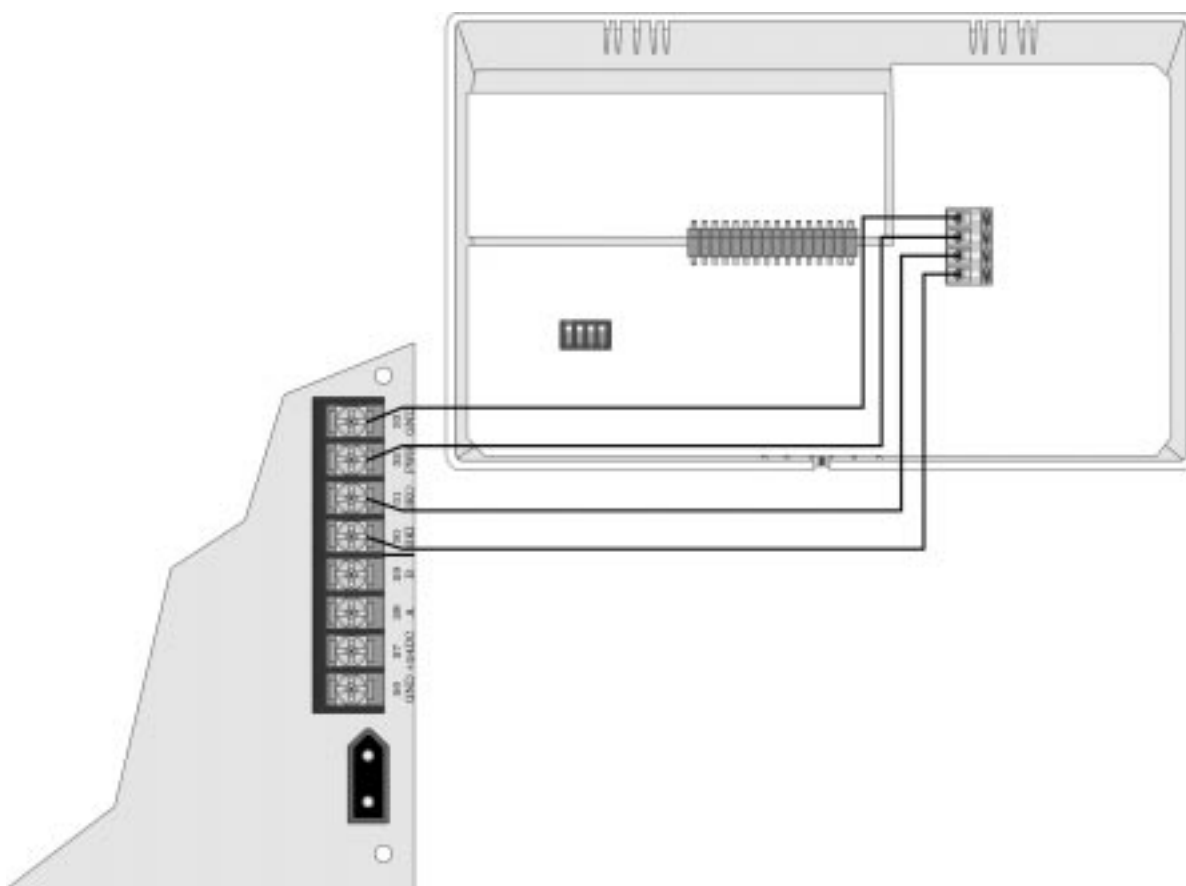

**SILENT
KNIGHT**

7550 Meridian Circle, Maple Grove, MN 55369-4927

800-446-6444 or in Minnesota 612-493-6435

FAX: 612-493-6475

World Wide Web: <http://www.silentknight.com>

MADE IN AMERICA

FORM# 350321, 01/00

Copyright © 2000 Silent Knight